



# MASTER

*Water Conditioning Corp.*

[www.masterwater.com](http://www.masterwater.com)

---

## Installation and Operation Manual



---

## Simplex Sulfur Removal Filters with 263/742 Logix Control Valve And Vortech Distributor

July 2008

## Table of Contents

Page No.	Topic	Description
1	Model # and Packaging	Packaging Information
	Component Packaging Description	Packaging Description
2	Filter System	System Positioning
	Filter Tank Loading	Filling with Media
	MBA Logix Control Valve	Valve Description
3	Logix 263/742 Control Valve	Attaching Valve to Tank Figure 1 & Figure 2
4	Service & Drain Piping, General Installation Layout, cont'd	Drain Piping Figure 3, cont'd
5	System Schematic	Piping Layout
6	Electrical Supply	Electrical Requirements
	Chlorine Tank	Installing Tank
7	Logix 263/742 Control Valve Electrical Connection	Instructions on Logix 742 Electrical Connection
	Filling filter with Water	Details for Filling filter Tank with Water
8	Filling filter with Water, cont'd	Details for Filling filter Tank with Water, cont'd
	Logix 263/742 Control Valve Timer	Instructions on Logix 742 Timer Settings
9	Logix 263/742 Control Valve Timer cont'd	Instructions on Logix 742 Timer Settings cont'd
	Final Check	Final Installation Check
10	Troubleshooting	Symptom / Cause / Solution
11	Troubleshooting	Symptom / Cause / Solution
12	Troubleshooting	Symptom / Cause / Solution
13	ERR Troubleshooting	Error Troubleshooting
14	263/742 Valve Body Schematic	Parts View
15	Valve Body Parts List	Part Numbers List
16	Valve Parts List	Part Numbers List
17	Warranty	Warranty

**Installation and Operating Instructions for**  
**263/742 Logix**  
**Top Mount Simplus Filter**

**Model #:**

_____	SIMPLUS 744	½ CF	Sulfur Removal Filter
_____	SIMPLUS 948	1 CF	Sulfur Removal Filter
_____	SIMPLUS1040	1 CF	Sulfur Removal Filter
_____	SIMPLUS 1054	1.5 CF	Sulfur Removal Filter

**Shipping Carton Description / unit:**

# of cartons	Contents	Description
1	Mineral tank	Distributor pipe installed
1	Chlorine tank	464 shutoff valve assembly.
	263/742 Logix Control valve	*NOTE: The 263 valve is shipped in the chlorine tank box. 742 timer and backwash flow control and bypass with 1" copper or pvc connection
	Simplus Media	½ -cubic foot boxes

**Filter Media is Packaged as Follows:**

Model #	Garnet*	Simplus Media
Simplus 744	N/A	(1) ½ CF
Simplus 948	N/A	(2) ½ CF
Simplus 1040	N/A	(2) ½ CF
Simplus 1054	N/A	(3) ½ CF

**NOTE: THE SIMPLUS UNITS HAVE THE NEW VORTECH PLATE DISTRIBUTOR AND NO LONGER REQUIRE GARNET.**

**NOTE: THIS SIMPLUS FILTER IS NOT INTENDED TO BE USED FOR TREATING WATER THAT IS MICROBIOLOGICALLY UNSAFE OR OF UNKNOWN QUALITY WITHOUT ADEQUATE DISINFECTION WHETHER BEFORE OR AFTER THE SYSTEM**

### ***System Description:***

The Simplus tank has a Logix top mounted automatic control valve with an electronic time clock to initiate regeneration. The Logix Valve is constructed of non-corrosive Noryl® material and is rated at a maximum working water pressure of 100 psi. It uses a 742 microprocessor based timer to actuate regeneration in the following ways:

- a. Manual regeneration button
- b. Regeneration day setting

### ***Simplus Positioning:***

1. Place Filter in desired position, far enough from walls and other obstructions to allow for servicing the unit.
2. Place the Filter within reasonable access to a grounded 115V/60 HZ circuit and a legal drain line connection.

### ***Simplus Tank Loading:***

1. Remove yellow caplug from top of tank. DO NOT CUT white riser tube. Tube was prefitted at the factory.
2. The distributor is permanently attached to the vortech----centering is not necessary. The top of the distributor will extend above the top of the tank (this was prefitted at the factory).
3. Cover the top opening of the distributor pipe before filling the tank with media.
4. Pour all filter media provided with the unit into the top of the tank. See page one for your specific model number of unit to determine the amount of media to load into the mineral tank.
5. Remove the material used to cover the top opening of the distributor pipe.

### **Logix Control Valve:**

1. When facing the front of the Logix timer, the inlet connection (**Figure 1**) is located on the left and the outlet connection is on the right. The control valve's inlet and outlet connections are either 1" copper or PVC equipped with gasket and nut.


Figure 1



Install the 263 bypass valve (**See Figure 2**) with inlet and outlet handles facing upward. Place gasket into nut and secure 1" copper or PVC tail piece with a nut. Repeat the procedure for the outlet connection.

**DO NOT OVERTIGHTEN THE NUT.**

Figure 2

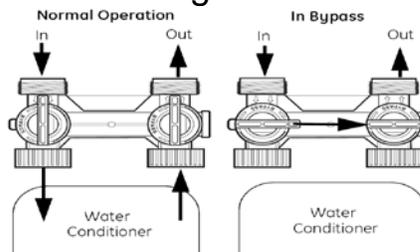

2. The control valve's drain connection is 3/4" npt and is located on the back of the bypass valve.
3. Turn the control valve upside down and ensure that the control valve distributor o'rings are in place. The o'rings are lubricated with silicone at the factory.
4. Fill mineral tank with water before installing control valve.
5. Place the control valve onto the distributor pipe.
6. Thread the control valve hand tight to 20 foot pounds!

**DO NOT OVERTIGHTEN!**


**\*\*DO NOT USE PETROLEUM!\*\***

**\*\*USE ONLY SILICONE \*\***

### ***Service and Drain Piping:***

1. Pipe Filter into the service lines .The inlet and outlet connections of the control valve are 1” copper or PVC and are located on the back of the valve body. As you face the timer the inlet is on the left and the outlet is on the right. Always follow local plumbing codes when installing our water treatment equipment.
2. If sweat fittings are used, be sure soldering is done in such a manner as not to allow heat to reach the control valve or bypass. (If Schedule 80 PVC is used make sure to follow the proper primer and solvent instructions.)
3. The drain line connection is located on the back of the control valve as you face the timer. It is recommended you install a 3/4” union on the drain line for servicing. The drain line must be of adequate size to allow for full regeneration flow.


Figure 3

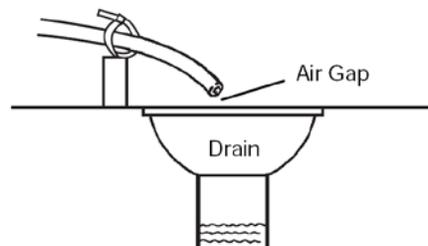

- The control valve drain connection is 3/4" npt.
- Never decrease the drain piping size to below 3/4"
- Maximum drain line length is 20 feet.
- Maximum drain line height is 6 feet above the control valve.
- The drain line must be piped to an open air gap (See Figure 3)
- Always follow local plumbing codes.

**UNDER NO CIRCUMSTANCES SHOULD THERE BE A DIRECT CONNECTION WITH SANITARY SEWAGE FACILITIES.**

### Typical Piping Layout

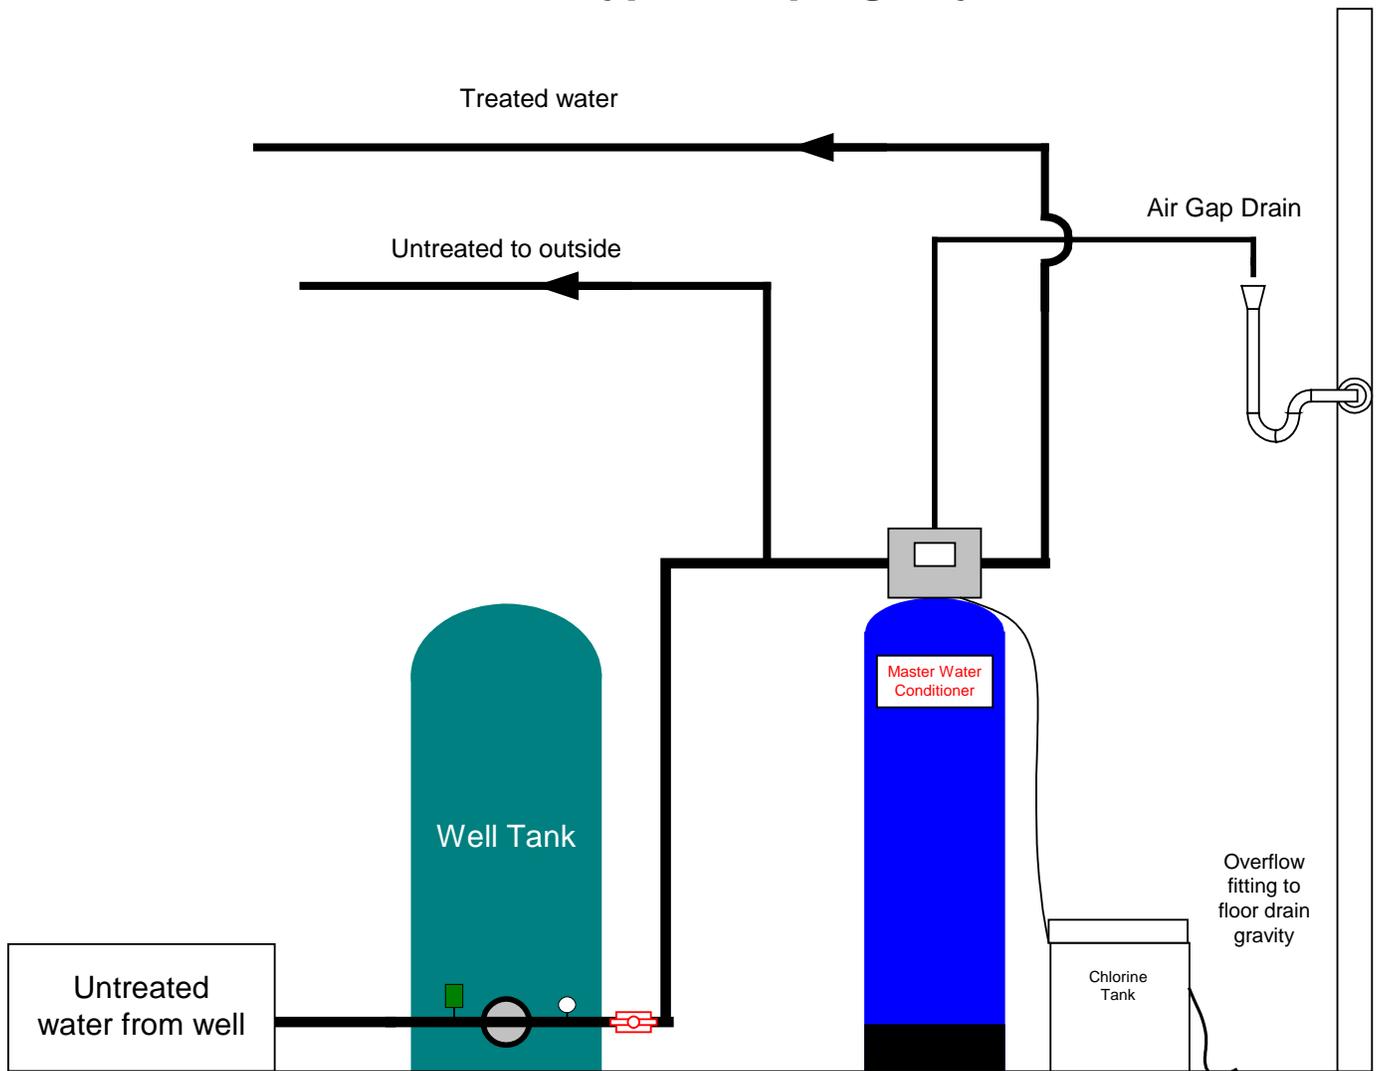

**NOTE:** All Master Water Conditioners must be installed after the well tank or water meter if its public water supply.

## **Electrical Requirements:**


Always follow all local electrical codes when installing our water treatment equipment.

1. Provide an 120v/60Hz properly grounded dedicated electrical Outlet. (It's very important that the polarity be correct)  
**Avoid using outlets that are switch controlled.**
2. Maximum amperage required is 5 amps.
3. Make sure the electrical service provides power 24 hours per day.  
We recommend installing a **surge protector** to protect unit from power surges, which are not covered by warranty.


## **Chlorine Tank:**

1. The Chlorine tank should be located directly beside the mineral tank.
2. Connect the 3/8" poly tubing to the 3/8" white elbow compression fitting located on the right side of the Logix control valve.

**See Figure Below.**

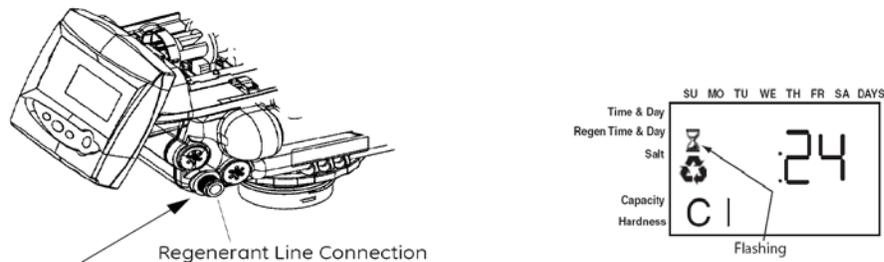


The Chlorine tank is equipped with a 464 shutoff valve, the float height was preset at the factory.

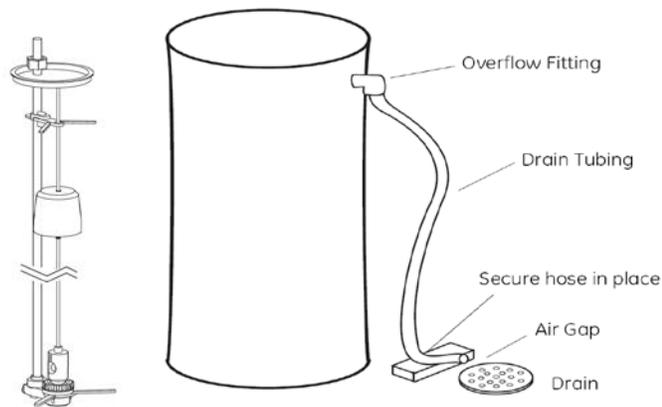

## Logix Control Valve Electrical Connection:

**Note:** Do not touch the wiring harness between the Logix timer and the motor, it's positioning is critical and therefore already installed at the factory.

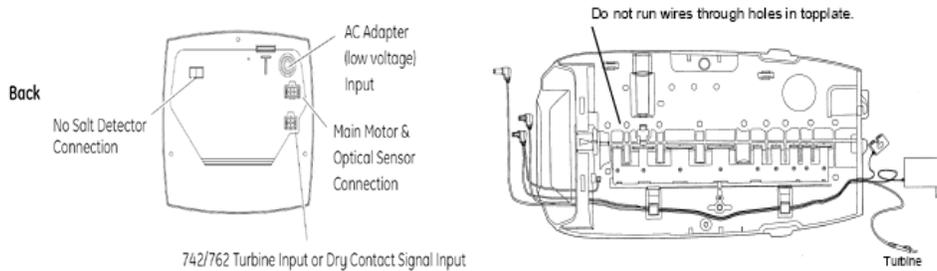

1. Remove plastic control valve cover by spreading sides while lifting.
2. Plug transformer into back of timer following existing wires.
3. Plug transformer into a properly grounded 120V/60 HZ electrical outlet.
4. The screen will now display “263” then the “Time of Day”.

## Filling Simplus with Water:

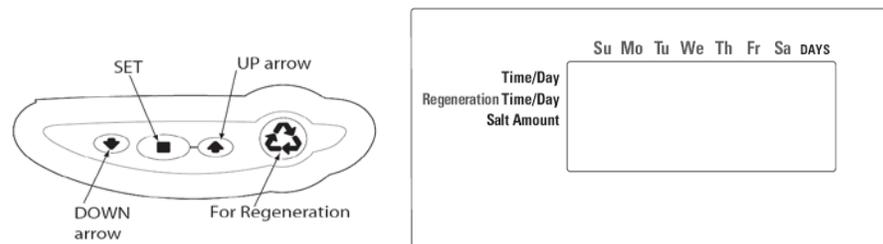


Figure 4

1. Push the FOR REGENERATION button (**Figure 4**) on the controller down for 5 seconds. This will initiate a manual regeneration. You will notice a flashing hour glass during regeneration. The controller will indicate that the motor is turning the camshaft to cycle C1 (BACKWASH). The controller will indicate the total regeneration time remaining. Filling tank in this position allows air to escape from drain. Open the bypass inlet valve  $\frac{1}{4}$  turn and allow water to flow into the mineral tank at a slow rate.

**Warning: IF WATER ENTERS THE TANK TOO FAST, ALL THE MEDIA WILL BE FLUSHED TO DRAIN DURING START UP.**

2. When water is running steadily at the drain, open the bypass valve's inlet and outlet to their maximum position. Simultaneously press the SET and UP buttons on the controller for 1 second then release, the motor will advance the cam to C2. Once C2 is displayed simultaneously press the SET and UP buttons on the controller for 1 second then release, the motor will advance the cam to C3. Repeat this procedure until the timer enters the C7 (FAST RINSE) position. The filter will go through the rinsing cycle and then automatically advance to (REGENERATION COMPLETE) C0 and Time of Day will be displayed. This is treated water.

**Regeneration Cycles:**

- C1 – Backwash
- C2 – Regeneration Draw/Slow Rinse (not used in filter mode)
- C3 – Slow Rinse (not used in filter mode)
- C4 – System Pause (to repressurize tank)
- C5 – Fast Rinse cycle 1
- C6 – Backwash cycle 2 (not used in filter mode)
- C7 – Fast Rinse cycle 2 (not used in filter mode)
- C8 – Regenerant Refill (not used in filter mode)

**Logix Control Valve Timer Settings:**

**Note:** The control valve is preset at the factory. You only need to set the time of day, day of week and regeneration frequency, which is preset at 1 am.

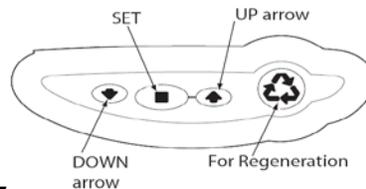


Figure 5

**Time of Day Setting**

- 1) Press the SET button. The screen will show the Time of Day in blinking numbers.
- 2) To change the Time of Day, use the UP or DOWN arrows.
- 3) Press the SET button.

### ***Day of Week Setting***

- 1) Press the SET button. The screen will show the Day of Week in blinking triangle.
- 2) To change the Day of Week, use the UP or DOWN arrows.
- 3) Press the SET button.

### ***Time of Regeneration Setting (the factory default is 1 AM)***

- 1) Press the SET button. The screen will show the Time of Regeneration in blinking numbers.
- 2) To change the Time of Regeneration, use the UP or DOWN arrows.
- 3) Press the SET button.

### ***Regeneration Frequency Setting (the factory default is 3)***

- 1) Press the SET button. The screen will show the Regeneration frequency in blinking numbers.
- 2) To change the number, use the UP or DOWN arrows.
- 3) Press the SET button.

If you wish to regenerate on certain days of the week, do the following:

- a. First, do steps above, but set at zero.
- b. Press SET button until you reach the day you wish to regenerate.
- c. Press the UP or Down arrows to set the day.
- d. Press the SET button to lock the day in.
- e. Repeat process to select the next day of regeneration.

NOTE: The days of Regeneration will be highlighted on the screen.

### ***Final Check:***

1. Inspect the treated water to assure that the media fines (color) have been flushed from the unit. Make sure the drain line connection meets all plumbing codes and that the drain line size can handle the backwash flow rate of the filter.
2. Make sure the Inlet and Outlet on bypass valve are open.
3. Make sure the control valve timer is plugged into an electrical outlet with power 24 hours per day.
4. Check all piping for leaks.

## Troubleshooting

**Problem:** Rotten egg odor returns

Possible Cause	Solution
Media bed may be fouled	Add 1 qt. of chlorox bleach and manually regenerate unit

**Problem:** Water conditioner fails to regenerate. No treated water.

Possible Cause	Solution
Faulty electrical supply	Verify that electrical power is getting to the outlet
Low inlet water pressure	Verify a minimum 30 psi inlet water pressure
Drain line restriction	Insure that the drain line is free of blockage
Defective timer motor	Replace timer motor
Manual bypass valve is open.	Close manual bypass valve.
Leak at riser pipe seal.	Insure that riser pipe is properly sealed at o'ring seal. Inspect pipe for cracks.
Plugged injector or injector screen.	Inspect and clean injector and/or injector screen.
Incorrect P Value Programming	Reprogram with proper P Value— See Insert Sheet.

**Problem:** No Chlorine Draw

Possible Cause	Solution
Plugged injector or injector screen.	Inspect and clean injector and/or injector screen.
Insufficient water pressure.	Verify a minimum 30 psi inlet water pressure
Obstructed drain line.	Remove obstruction.

**Problem:** Insufficient chlorine draw

<b>Possible Cause</b>	<b>Solution</b>
Partially clogged injector or injector screen.	Inspect and clean injector and/or injector screen assembly.
Insufficient water pressure.	Verify a minimum 30 psi inlet water pressure
Excessive back pressure on injector due to elevated drain line.	Reduce drain line elevation to height of valve.
Incorrect P Value Programming	Reprogram with proper P Value
Partially restricted drain line.	Remove restriction.

**Problem:** Loss of Media to Drain

<b>Possible Cause</b>	<b>Solution</b>
No flow control installed in drain line.	Install drain line flow control.
Air in feed water	Check well pump & bladder tank

**Problem:** Leak to Drain

<b>Possible Cause</b>	<b>Solution</b>
No flow control installed in drain line.	Install drain line flow control.
Insufficient water pressure.	Increase water pressure above 30 psig (172kPa) minimum.
Media stuck under valve gates	Remove top plate and valve and flush out media

**Problem:** Loss of Water Pressure

<b>Possible Cause</b>	<b>Solution</b>
Fouled media bed due to iron.	Clean control valve and mineral bed with cleaner.
Slots in riser pipe or laterals are filled with media fines.	Inspect and clean distributor pipe slots as needed.
Insufficient well pump	Check well pump gpm (gallons per minute)

**Problem:** Timer does not display time of day

<b>Possible Cause</b>	<b>Solution</b>
AC Adapter unplugged	Connect power
No electric power at outlet	Repair outlet or use working outlet
Defective AC Adapter	Replace AC Adapter
Defective Timer	Replace Timer

**Problem:** Timer does not display correct time of day

<b>Possible Cause</b>	<b>Solution</b>
Switched outlet	Use uninterrupted outlet
Power Outage	Reset time of day
Defective Timer	Replace Timer

**Problem:** Control Valve regenerates at wrong time of day


<b>Possible Cause</b>	<b>Solution</b>
Power Outages	Reset control valve to correct time of day
Time of day not set correctly	Reset to correct time of day
Time of regeneration incorrect	Reset regeneration time to 2:00 am.

## TROUBLESHOOTING

### 700 Series Controller Troubleshooting

Problem	Possible Cause	Solution
ERR 1 is displayed	Controller power has been connected and the control is not sure of the state of the operation.	Press the UP arrow and the control should reset.
ERR 2 is displayed	Controller power does not match 50 or 60 Hz.	Disconnect and reconnect the power. If problem persists, obtain the appropriate controller or AC adapter for either 50 or 60 Hz power.
ERR 3 is displayed	Controller does not know the position of the camshaft. Camshaft should be rotating to find Home position.	Wait for two minutes for the controller to return to Home position. The hourglass should be flashing on the display indicating the motor is running.
	Camshaft is not turning during ERR 3 display.	Check that motor is connected. Verify that motor wire harness is connected to motor and controller module. Verify that optical sensor is connected and in place. Verify that motor gear has engaged cam gear. If everything is connected, try replacing in this order: <ul style="list-style-type: none"> <li>–Wire harness</li> <li>–Motor</li> <li>–Optical sensor</li> <li>–Controller</li> </ul>
	If camshaft is turning for more than five minutes to find Home position:	Verify that optical sensor is in place and connected to wire. Verify that camshaft is connected appropriately. Verify that no dirt or rubbish is clogging any of the cam slots. If motor continues to rotate indefinitely, replace the following components in this order: <ul style="list-style-type: none"> <li>–Wire harness</li> <li>–Motor</li> <li>–Optical sensor</li> <li>–Controller</li> </ul>
Four dashes displayed: -- : --	Power failure occurred	Press SET to reset the time display.

# Performa Exploded View

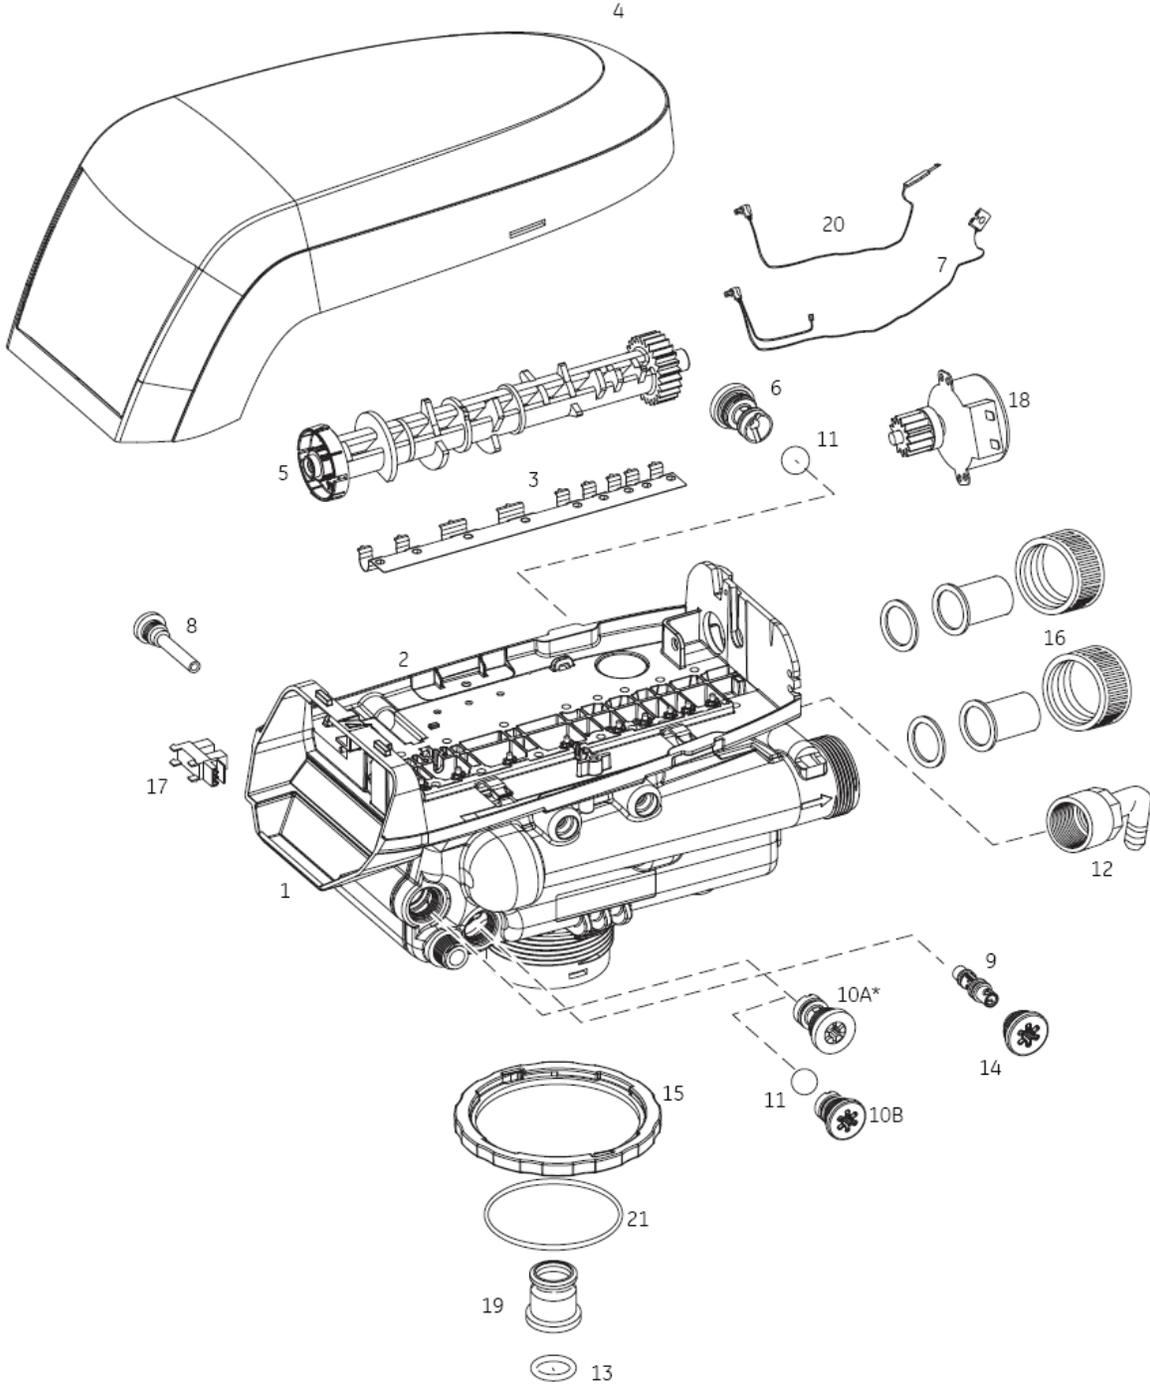


\*Warning: Do not use the flow control ball with #10A.

## Performa Parts List


Part				Part			
Code	No.	Description	Qty.	Code	No.	Description	Qty.
1	1244651	Valve Assembly w/o Flow Controls	1	1035735	"K" Injector (High Efficiency) - Pink (12-inch tank)		
2	1235338*	Top Plate, 268/700 Series Valves	1	1035736	"L" Injector (High Efficiency) - Orange (13 & 14-inch tanks)		
3	1235339*	Valve Disc Spring, One Piece, Performa Valve	1	1032978	Plugged Injector for 263 Filter		
4	1236246*	Cover, Valve, 255/Performa 700/860 Series Controller	1	1032985	Plugged Injector Cap		
5		Performa Logix Camshafts	1	10A	1000222	Regenerant Refill Controller, No Bal, 0.33 gpm	1
	1235352*	Cam, 263-268/700-860 Series Valve, STD, Black		10B	1243510	Regenerant Refill Controller	
	1237402*	Cam, 269/700-860 Series Valve, STD, Green		11	1030502	Ball, Refill Flow Control	
	1237403*	Cam, 273/700-860 Series Valve, STD, Gray		*	1030334	Plugged Refill Flow Control - for 263 Valve	
	1237404*	Cam, 273/700-860 Series Valve, TWIN (insert)		12	1002449	Drain Fitting Elbow (3/4-inch hose barbed)	1
	1237405*	Cam, 278/700-860 Series Valve, STD, Brown		13	1010428	O-Ring	1
	1237406*	Cam, 278/700-860 Series Valve, TWIN, Tan (insert)		14	1000269	Injector Cap with O-Ring	1
6		Drain Control Assembly:	1	15	1035622	Tank Ring	1
	1000209	No. 7 (1.3 gpm; 4.9 Lpm)		*	1041174	Valve Disc Kit: Standard	
	1000210	No. 8 (1.7 gpm; 6.4 Lpm)		16	Plumbing Adapter Kits:	1	
	1000211	No. 9 (2.2 gpm; 8.3 Lpm)			1001606	3/4-inch Copper Tube Adapter Kit	
	1000212	No. 10 (2.7 gpm; 10.2 Lpm)			1001670	1-inch Copper Tube Adapter Kit	
	1000213	No. 12 (3.9 gpm; 14.76 Lpm)			1001608	22-mm Copper Tube Adapter Kit	
	1000214	No. 13 (4.5 gpm; 17 Lpm)			1001613	3/4-inch CPVC Tube Adapter Kit	
	1000215	No. 14 (5.3 gpm; 20 Lpm)			1001614	1-inch CPVC Tube Adapter Kit	
	1239760	Blending Valve Kit 900/700 Series Top Plate			1001615	25-mm CPVC Tube Adapter Kit	
*		Drain Line Flow Control (External)	1		1001769	3/4-inch NPT Plastic Pipe Adapter Kit	
	1030355	Drain Line Flow Control, 5 gpm (19 Lpm)			1001603	1-inch NPT Plastic Pipe Adapter Kit	
	1030356	Drain Line Flow Control, 6 gpm (22.5 Lpm)			1001604	3/4-inch BSPT Plastic Pipe Adapter Kit	
	1030357	Drain Line Flow Control, 7 gpm (26.5 Lpm)			1001605	1-inch BSPT Plastic Pipe Adapter Kit	
	1030358	Drain Line Flow Control, 8 gpm (30 Lpm)			1001611	3/4-inch BSPT Brass Pipe Adapter Kit	
	1030359	Drain Line Flow Control, 9 gpm (34 Lpm)			1001610	1-inch NPT Brass Pipe Adapter Kit	
	1030360	Drain Line Flow Control, 10 gpm (38 Lpm)			1001612	1-inch BSPT Brass Pipe Adapter Kit	
7	1235269	Motor/Optical Cable Assembly, 700 Series Controller	1	17	1235373	Module, Sensor, Photo Interrupter	1
8	1000226	Screen/Cap Assembly w/ O-Ring	1	18	1235361	Motor w/Spacer & Pinion, 700 Series Controller, 12 V, 50/60 Hz	1
9		Injector (High Efficiency) Options		19	1001986	13/16 inch Rubber Insert (Optional)	1
	1035730	"E" Injector (High Efficiency) - Yellow (6-inch tank)		20	1235446	Turbine Cable	1
	1035731	"F" Injector (High Efficiency) - Peach (7-inch tank)		21	1010154	Tank O-Ring	1
	1035732	"G" Injector (High Efficiency) - Tan (8-inch tank)		*	1033444	Internal Turbine Meter	
	1035733	"H" Injector (High Efficiency) - Lt Purple (9-inch tank)		*	1233187	Motor Locking Pin	
	1035734	"J" Injector (High Efficiency) - Lt Blue (10-inch tank)		*	1299336	Chlorine Generator Kit	
				*	1033444	Turbine Assembly	
				*	1041174	Valve Disc Kit, Standard	
				*	1239979	Cable Harness, Remote Regen 740F	
				*	1239711	Switch Kit, Front Mount, 0.1 amp	
				*	1239752	Switch Kit, Front Mount 5 amp	
				*	1239753	Switch Kit, Top Plate Mount, 0.1 amp	
				*	1239754	Switch Kit, Top Plate Mount, 5 amp	

\*Not shown on drawing.


## Logix 700 Series Controllers Parts List

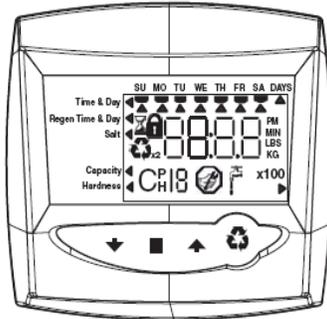

742/762 Control



AC Adapter

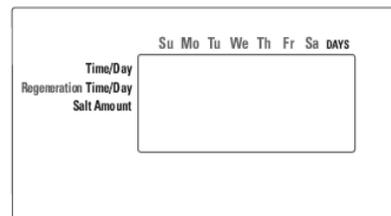

700 Control Overlays

Part				Part			
Code	No.	Description	Qty.	Code	No.	Description	Qty.
		Electronics Modules/Controllers	1			AC Adapter	
1242150		Logix 742 Controller		1000810		Japanese	
1242162		Logix 742 F Controller		1000811		North American	
1242168		Logix 762 Controller		1000812		Australian	
1242170		Logix 762F Controller		1000813		British	
		Electrical Components		1000814		European	
1235269		Motor/Optical Cable Assembly, 700 Series Control		1030234		Transformer Extension Cord 15 foot (4.5m)	
1235373		Module, Sensor, Photo Interrupter		1235448		North American Outdoor AC Adapter Overlays	
1235361		Motor w/Spacer & Pinion, 700 Series Controller 12V, 50/60 Hz		1238472		Overlay, 716 Controller, English	
1244336		Refill Sensor Probe for Salt Detector Applications		1238476		Overlay, 740C/742C Controller, English	
1256257		Remote Mount Kit					

# 12 YEAR LIMITED WARRANTY

As of Oct. 1, 1995

This Residential Water Conditioner is warranted for a period of **one year** from date of purchase by first user against defects in materials and workmanship. In addition, the complete control valve is warranted for **five years**. The control valve body (excluding internals and electrical parts) is warranted for **six years**. The mineral tank, plastic brine tank or cabinet tank (excluding mineral) is warranted against rust, corrosion or bursting for a period of **twelve years** from date of manufacture. Except, as specifically set forth in this paragraph, Master Water Conditioning Corporation makes no other warranties, express or implied.

This warranty shall be void if the conditioner is moved from the place of original installation, or if damage is caused by misuse, misapplication, accident, freezing, flood, fire or if not installed in accordance with instructions furnished by Master Water Conditioning Corporation.

This warranty shall be void in the event of damages from external sources or where the conditioner has been operated at pressure in excess of 100 pounds per square inch or at a temperature greater than 100 degrees F. or less than 32 degrees F. Incidental costs or consequential damages are not covered by this warranty.

All defective parts shall be returned prepaid to Master Water Conditioning Corporation for inspection. **Master shall not be liable for labor charges other than Master factory repairs.**

This warranty gives you specific legal rights, and you may have other rights which vary from state to state. Some states do not allow limitations on duration of implied warranties or exclusion of incidental or consequential damages, so the above limitations may not apply to you.

All claims must be submitted in writing to Master Water Conditioning Corporation at 224 Shoemaker Road, Pottstown, Pennsylvania 19464 within thirty (30) days from the discovery of the defect. Master Water Conditioning Corporation thereafter will correct defective parts and workmanship or rusting, corrosion or bursting within sixty (60) days.

Failure to notify Master by completing, signing and returning the registration card within twenty (20) days of the purchase shall void the warranty.



224 Shoemaker Rd. Pottstown, Pa. 19464



**Congratulations on your purchase! Thank you for choosing Master Water Conditioning equipment.**

***System Description:***

You have purchased a state of the art water conditioning unit which removes sulfur odor from your raw water supply . It's simple, with very little maintenance.


***Maintenance May Include the following:***

1. After installation, if the odor returns, but only on occasion, it may be from residual in your homes piping and it would be good to call your installer to chlorinate all the piping in your home.
2. If odor returns and remains, your unit may need extra media cleaning.

This is done with chlorine bleach.

- To do this, you would add 1 quart of unscented chlorine bleach to the chlorine tank. This process allows the media to be thoroughly cleaned during the next regeneration. If a chlorine bleach odor is noticed the next morning, run your water at a faucet until it is clear of any chlorine bleach odor.
3. Yearly maintenance is important by your installer to clean the injector and screen and to confirm your unit is working properly.
  4. If the power goes out you should confirm all timer settings are correct to insure the unit will regenerate on time and properly. See next page for timer setting information.

**To Set the Simplus Timer follow the steps below:**



### **Time of Day Setting**

- 1) Press the **SET** button. The screen will show the Time of Day in blinking numbers.
- 2) To change the Time of Day, use the **UP** or **DOWN** arrows.
- 3) Press the **SET** button.

### **Day of Week Setting**

- 1) Press the **SET** button. The screen will show the Day of Week in blinking triangle.
- 2) To change the Day of Week, use the **UP** or **DOWN** arrows.
- 3) Press the **SET** button.

### **Time of Regeneration Setting** (the factory default is 1 AM)

- 1) Press the **SET** button. The screen will show the Time of Regeneration in blinking numbers.
- 2) To change the Time of Regeneration, use the **UP** or **DOWN** arrows.
- 3) Press the **SET** button.

### **Regeneration Frequency Setting** (the factory default is 3)

- 1) Press the **SET** button. The screen will show the Regeneration frequency in blinking numbers.
- 2) To change the number, use the **UP** or **DOWN** arrows.
- 3) Press the **SET** button.

If you wish to regenerate on certain days of the week, do the following:

- a. First, do steps above, but set at zero.
- b. Press SET button until you reach the day you wish to regenerate.
- c. Press the UP or Down arrows to set the day.
- d. Press the SET button to lock the day in.
- e. Repeat process to select the next day of regeneration.

**NOTE:** The days of Regeneration will be highlighted on the screen.